THIS DOCUMENT IS TRUE AND CORRECT AT TIME OF PUBLICATION. CONTINUED PRODUCT IMPROVEMENTS MAKE SPECIFICATIONS AND MEASUREMENTS SUBJECT TO CHANGE WITHOUT NOTICE.

NOTES:

1. AUDIBLE AND VISIBLE ALARM ACTIVATED WHEN SHOWER OR EYEWASH IS IN USE.
2. 120VAC SUPPLY VOLTAGE REQUIRED, APPROXIMATELY 100VA ALL ELECTRICAL HOOKUPS TO MAIN JUNCTION BOX.
3. SYSTEM CERTIFIED AS SUITABLE FOR CLASS I, DIV. 2 GROUPS B, C, D LOCATION INSTALLATION. INSTALLER MUST USE THREAD SEALANT, SUCH AS APPLETON TLC3, RECOMMENDED FOR USE IN HAZARDOUS LOCATIONS ON ALL ELECTRICAL NPT CONNECTIONS.

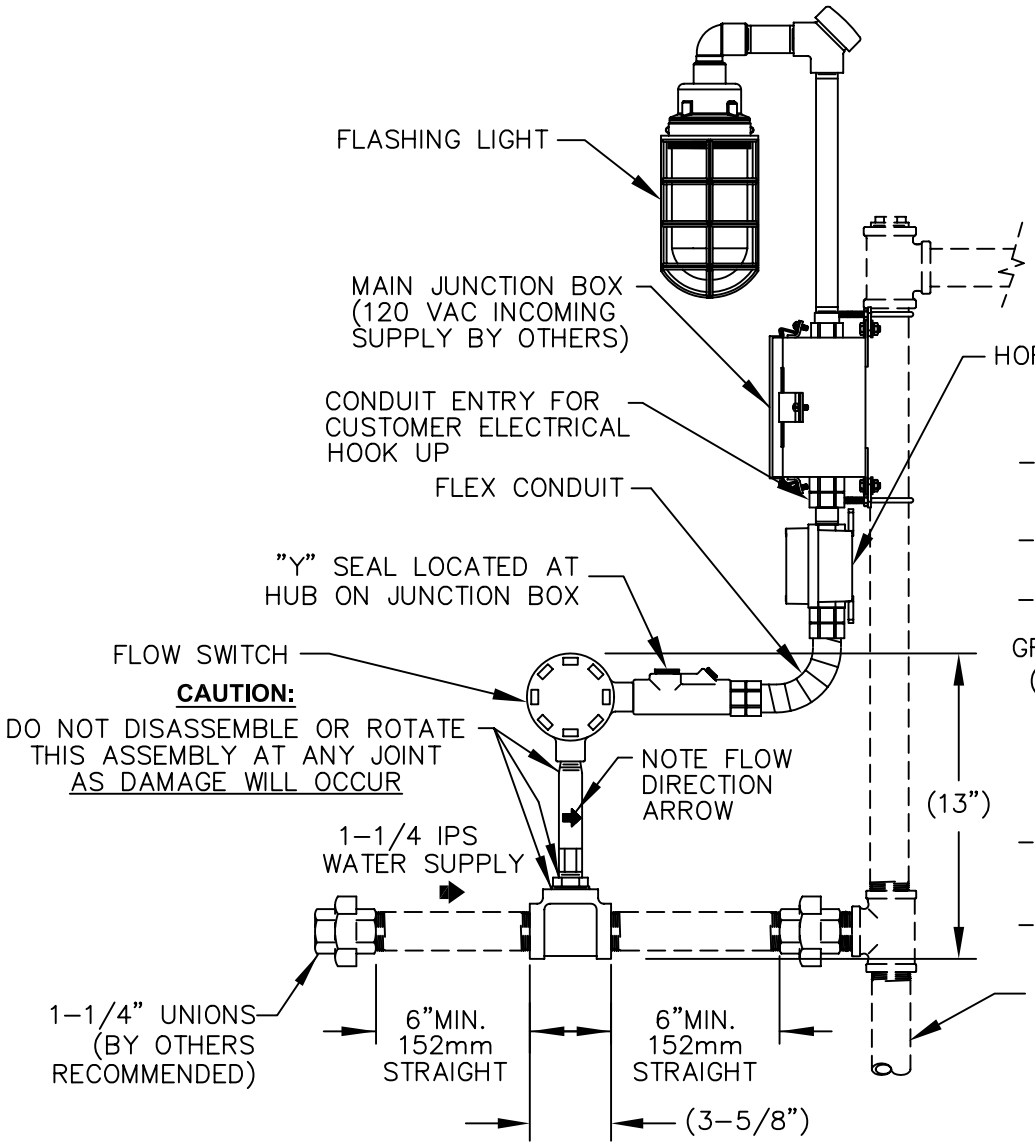

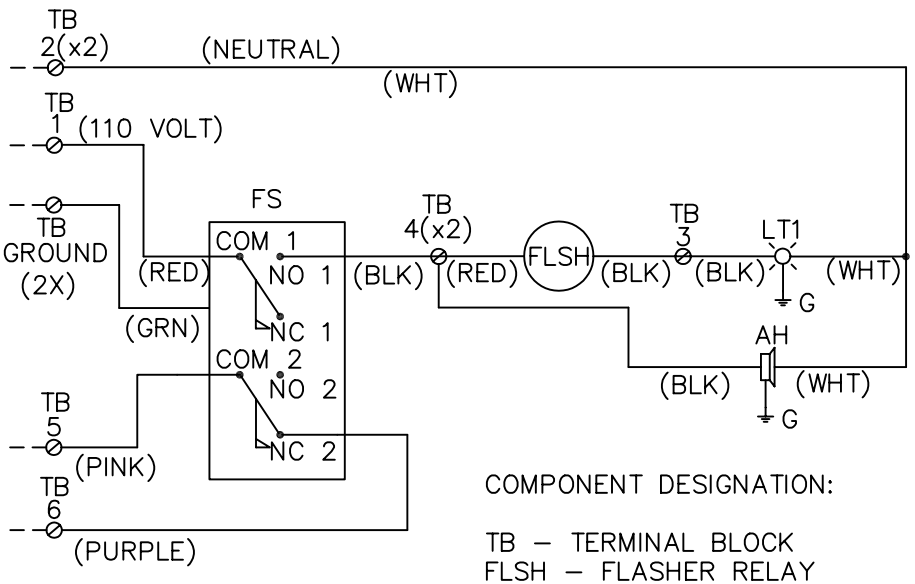

COMPONENT DESIGNATION:

TB – TERMINAL BLOCK
FLSH – FLASHER RELAY
LT1 – RED LIGHT
FS – FLOW SWITCH
AH – ALARM HORN

SWITCH MUST BE MOUNTED IN HORIZONTAL POSITION

Haws corporation
1455 KLEPPE LANE
SPARKS, NEVADA 89431
(775) 359-4712 FAX (775) 359-7424
E-MAIL: HAWS@HAWSCO.COM
WEBSITE: WWW.HAWSCO.COM

ECN NO.	REVISED PER	BY:
.	ECN: 4274	BW
DRAWN:	DATE:	CHK'D.:
CJL	06/91	
APPROVED:	DATE:	

MODEL(S):
9001EXP ALARM
INFO FAX DOC #: 29001397
SCALE: 1:8 DRAWING TYPE: INSTALLATION/FAXBACK

PART NUMBER: 0002080203.D
DRAWING NUMBER: 09648A00 REV. 16
SIZE: A SHEET 1 OF 1

DWG.NO. 09648A00

©2009 Haws Corporation - All Rights Reserved HAWS® and other trademarks used in these materials are the exclusive property of Haws Corporation.